

**ENVIRONMENTAL REPORT**

**TO: Rory O'Callaghan, SEE Environment**

**FROM: Ann Marie Callan, Executive Scientist**

**RE: Water Quality Monitoring at New 400/110KV Substation at Coolnabacky.**

**Date: 15 September 2022**

On 24/08/2022, I carried out an inspection of the Substation site at Coolnabacky and noted the following:

1. No construction works or operations on site at time of inspection.
2. Landdrains were dry at time of inspection due to good weather conditions.
3. No unauthorised discharges to surface waters noted.
4. All watercourses on and adjacent the site was noted to be of good quality with no evidence of unauthorised discharges/contamination that would give rise to a deterioration in water quality.

See photographs attached.


Signed: \_\_\_\_\_

Ann Marie Callan

Date: \_\_\_\_\_

15/09/22

Photographs taken by Ann Marie Callan on 24/08/22 at EIRGRID Substation site at Coolnabacky

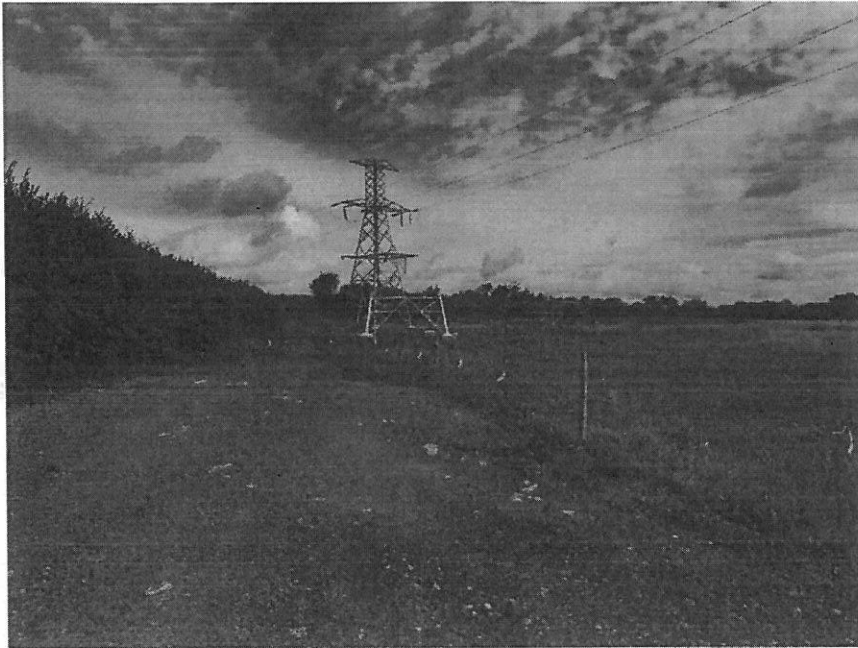

*Figure 1: No works or operations on site at time of inspection*



*Figure 2: No works or operations on site at time of inspection*




*Figure 3: Newly constructed road complete*



*Figure 4: No operations or works on site*



*Figure 5: Satisfactory protection of land drains*

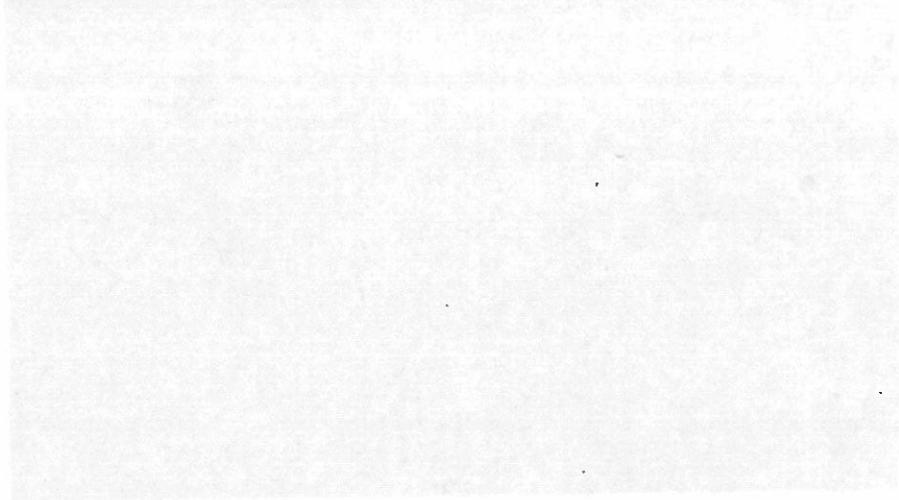

© 2014 The Authors. Journal compilation © 2014 Blackwell Publishing Ltd